



Location:

~~GARNETT PLACE~~
Rosewind House

SPRINKLER
COVERAGE

PRE-PLAN

Address:

5815 Coffey St.

Full

R 1

FDC



Lock
Box
K


Fire Alarm
Control Panel
FACP

Gas Meter

Fire Door

Fire Hydrant
H

291' 10"

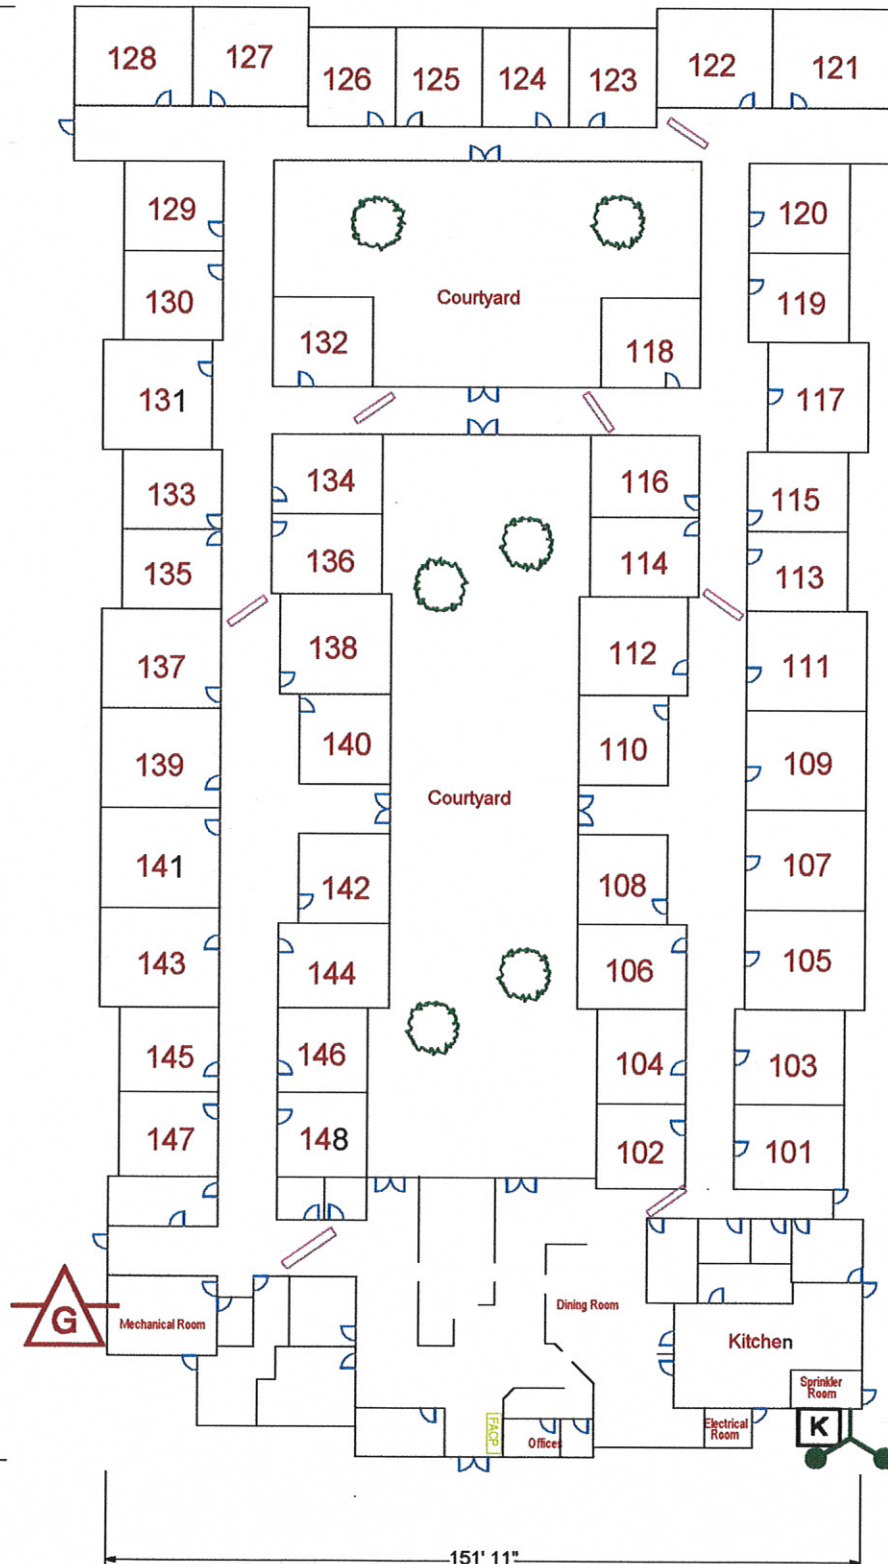

Address	5815 Coffey	District	201
Name	Rosewind House GARVET PLACE	Lock Box	Yes

FIRE DEPARTMENT
Date 2/23/02 By 610

Type of Business		Assisted Living	
Fire Control System		Fully Sprinklered	
CONSTRUCTION INFORMATION			
Ht.	Flr.	Lth	Wth
		292'	152'
Roof		2' x 6' Truss	
Exterior Wall			
Floor			
Area And Water Supply			
Special Conditions and Hazards		Consider protecting the patients in their rooms Confine fire with the fire doors. Up to 100 physically challenged occupants. Need additional manpower if evacuation is needed Some rooms will have liquid or compressed oxygen	
Base Fire Flow		5% = 683gpm 10% = 1367gpm 25% = 3418gpm 50% = 6837 75% = 10255gpm 100% = 13674gpm	
Emergency Phone		861-5872	
Business Phone		377-9980	
Contact		Mary Lewerenz	



Address

5815 Coffey

District

201

Lock Box

Yes

Marigold